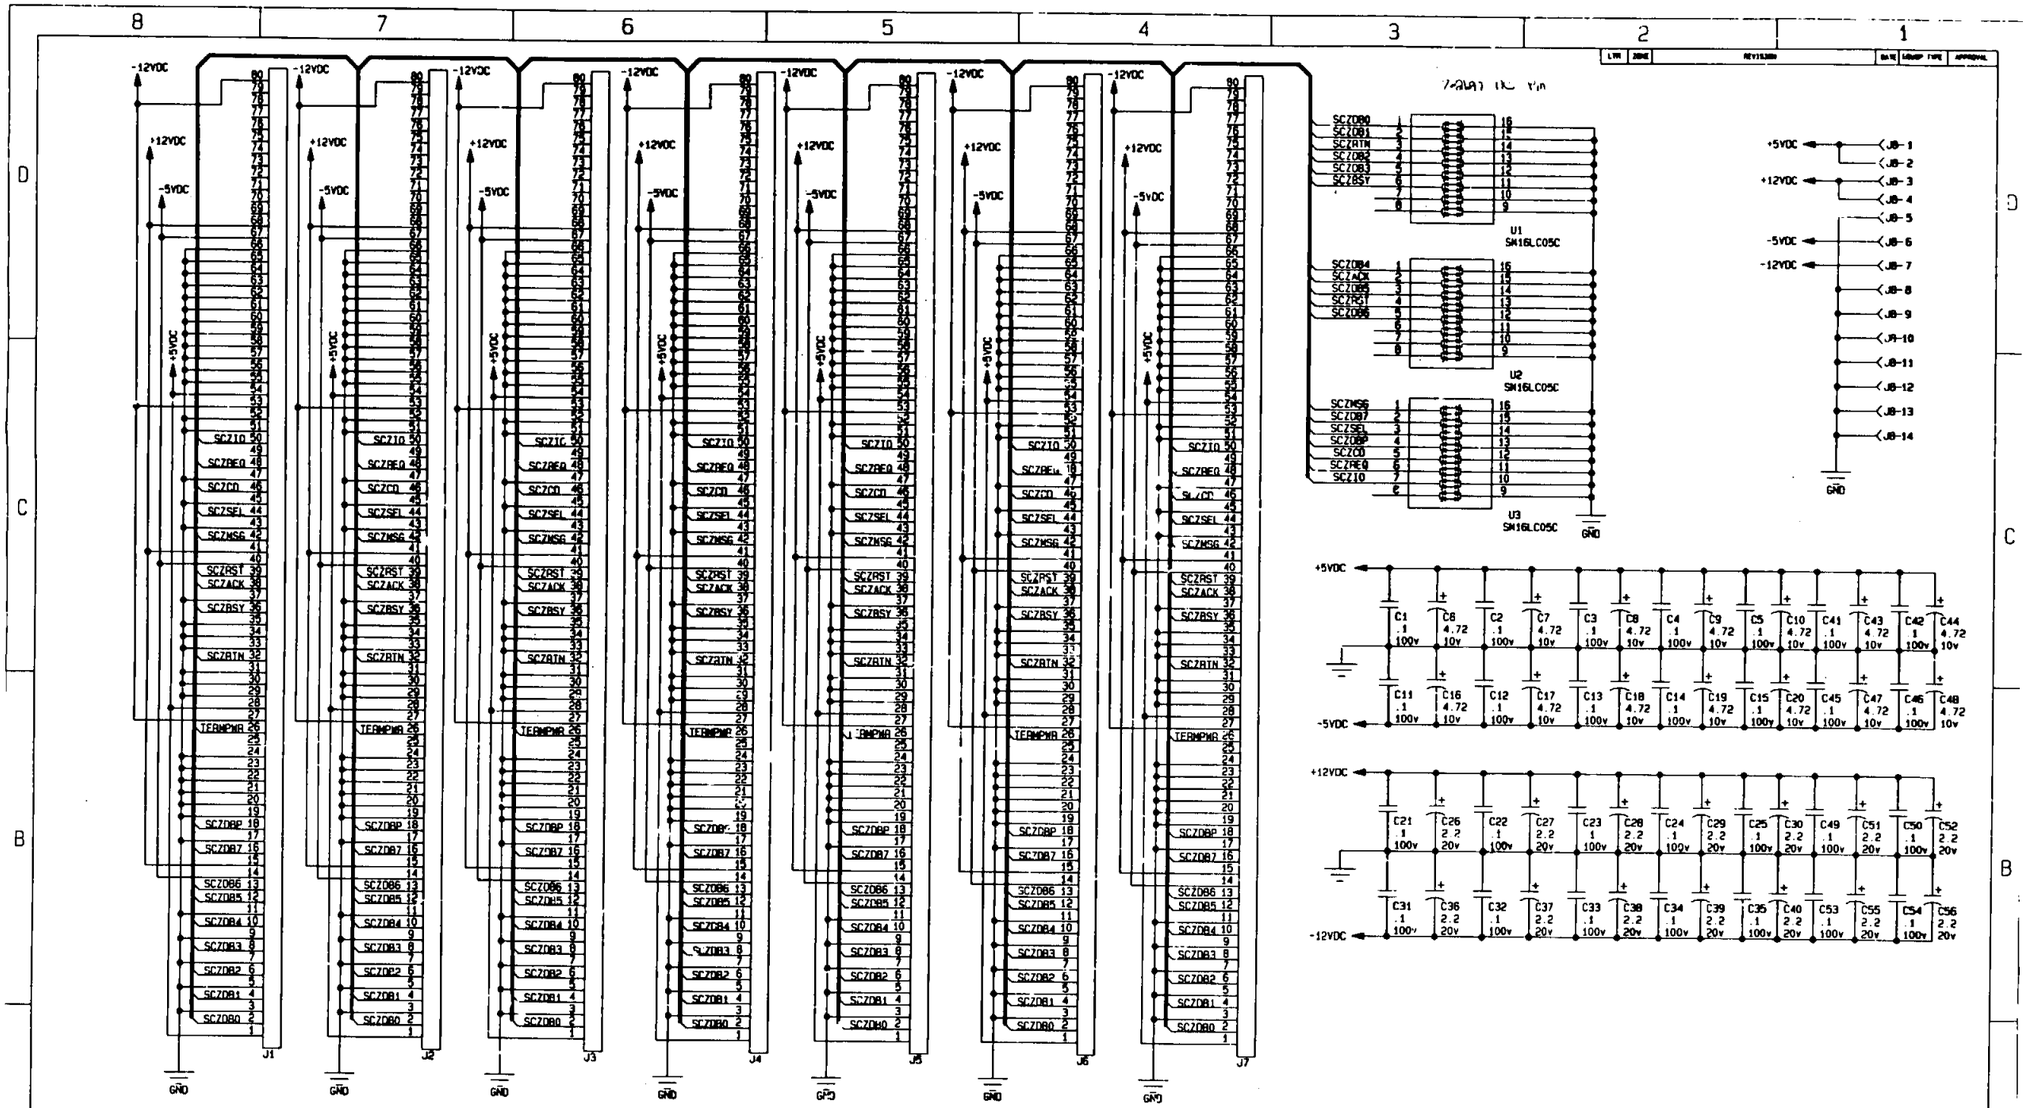

6. LAST REFERENCE DESIGNATOR USED: J8, C56, U3
5. REFERENCE DESIGNATORS NOT USED:
4. THIS SCHEMATIC USED IN CONJUNCTION WITH SEG46114415-301.
3. CAPACITOR VALUES ARE IN MICRO FARADS.
2. RESISTOR VALUES ARE IN OHMS, 1/4 WATT, 1%.
1. INTERPRET DRAWING PER JSCM 8500.

NOTES: UNLESS OTHERWISE SPECIFIED

SIGNATURES	DATE	NATIONAL AERONAUTICS & SPACE ADMINISTRATION
DR R. GRANTZ	30 MAR 96	LYNDON B. JOHNSON SPACE CENTER HOUSTON, TEXAS
ENG	9/11/96	PRINTED WIRING DIAGRAM
CH	9/12/96	LIME DISK ARRAY
APP	7-17-97	HRF WORKSTATION
DE	7-16-97	
MAT	6/23/97	
STRESS	6/21/97	CODE IDENT NO. 21356 · SIZE D · DWG NO. SIG46114413 · REV
AUTH	7-17-97	SCALE NONE · SE PROJECT: B104 · SHEET 1 OF 1

CALC WT.

HDR FILE: \PCAD\RELEASE\SCH

HDR FILE: 4413SH1.HP

HDR REV: SEG46114415

DRAW TYPE: ☒ FLT HDWR ☐ DRAWN DIRECTIVE ☐ APPLICABLE SEE

419